


# Certificate of Analysis

FULL QUALITY CONTROL PANEL · PEPTIDE ANALYTICAL REPORT

CERTIFICATE NO.  
**COA-2026-2649**

Issued 06/13/2026 · Page 1 of 4

<b>CLIENT</b>  <b>PeptaraLabs</b> <a href="https://PeptaraLabs.io">PeptaraLabs.io</a>  Client reference: on file Distribution: client confidential	<b>PREPARED FOR</b>  (Empty)	<b>SAMPLE &amp; ACCESSION</b>  ACC-2026-4920  ANALYTE / IDENTITY: <b>SLU-PP-332</b> CAS NUMBER: <b>303760-60-3</b> LOT NUMBER: <b>SLU-260405-A</b>  LABELED CONTENT: <b>5 mg</b> SAMPLE MATRIX: <b>Lyophilized</b> APPEARANCE: <b>Conforms</b>  MANUFACTURED: <b>04/05/2026</b> RETEST / EXPIRY: <b>04/2028</b> STORAGE: <b>-20 C, dark</b>  DATE RECEIVED: <b>06/11/2026</b> DATE ANALYZED: <b>06/13/2026</b> DISPOSITION: <b>RELEASED</b>	<b>ACC-2026-4920</b>  SAMPLE PHOTOGRAPH AS RECEIVED    SLU-PP-332 · 5 mg · Lyophilized
--	------------------------------------	---	--

<b>ASSAY PURITY</b> <span>✓ PASS</span> <b>98.96%</b> Spec ≥ 95.0%	<b>IDENTITY</b> <span>✓ PASS</span> <b>SLU-PP-332</b> HPLC-RTM + LC-MS	<b>NET CONTENT</b> <span>REPORTED</span> <b>5.08</b> mg measured · label 5 mg	<b>BACTERIAL ENDOTOXIN</b> <span>✓ PASS</span> <b>≤0.05</b> EU/mL · limit NMT 5	<b>DISPOSITION</b> <b>RELEASED</b> Full QC Panel complete
--	--	---	---	---

**1 RELEASE STATEMENT** Authorized Disposition


The submitted SLU-PP-332 sample was evaluated under the Full Quality Control Panel covering identity, purity, net compound content, composition, sterility, bacterial endotoxin, elemental impurities, and targeted adulterant screening. Identity was confirmed by HPLC retention-time matching with an LC-MS [M+H]<sup>+</sup> ion at m/z 291.3 (neutral mass 290.3 Da). Chromatographic purity of 98.96 percent comfortably exceeded the not less than 95.0 percent release criterion. Sterility returned No Growth, bacterial endotoxin was well within the applicable limit, and arsenic, cadmium, chromium, mercury, and lead were each Not Detected, with fentanyl Not Detected at the screening cutoff. On the basis that all tested attributes meet their respective specifications, the laboratory supports a disposition of RELEASED for the material as received.

<b>IDENTITY</b> Confirmed <span>✓ PASS</span>	<b>PURITY</b> 98.96% <span>✓ PASS</span>	<b>NET CONTENT</b> 5.08 mg <span>✓ PASS</span>	<b>MOISTURE</b> 3.50% w/w <span>✓ PASS</span>	<b>STERILITY</b> No Growth <span>✓ PASS</span>	<b>ENDOTOXIN</b> ≤0.05 EU/mL <span>✓ PASS</span>	<b>HEAVY METALS</b> Not Detected <span>✓ PASS</span>
---	--	--	---	--	--	--

**2 PURITY, QUANTITATION & IDENTITY** HPLC / HPLC-RTM


ANALYTE	SPECIFICATION	RESULT	UNIT	STATUS
Assay Purity (HPLC)	≥ 95.0%	<b>98.96</b>	%	<span>✓ PASS</span>
Net Compound Content	Report only	<b>5.08</b>	mg	<span>REPORTED</span>
Identity (HPLC-RTM)	SLU-PP-332	<b>Confirmed</b>	—	<span>✓ PASS</span>
Fentanyl Screen	Immunoassay, 50 ng/mL	<b>Not Detected</b>	—	<span>✓ PASS</span>

**Interpretation.** The measured chromatographic purity of 98.96 percent exceeds the not less than 95.0 percent release criterion, indicating a homogeneous principal peak with a low related-substance burden. Net compound content of 5.08 mg is the measured mass recovered from the unit and is reported against a nominal 5 mg label claim, confirming the vial delivers at least the labeled mass of active compound.

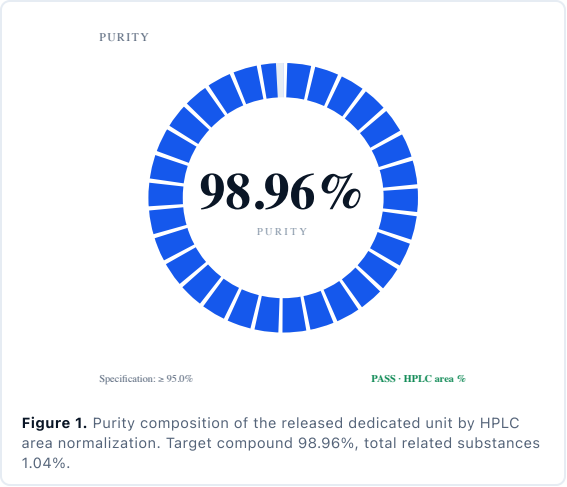

**3 REPRESENTATIVE CHROMATOGRAM**

Reversed-phase HPLC-UV

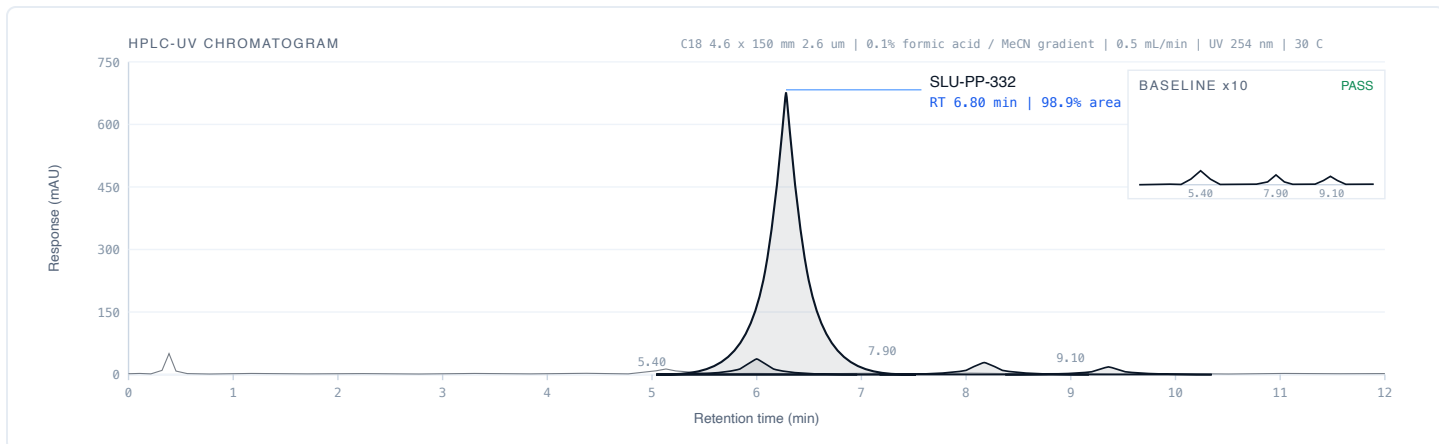


**Figure 2.** Representative reversed-phase HPLC-UV chromatogram (Conformity unit V1, 98.90% main-peak area, near the batch mean of 98.93%). Trace related substances are shown magnified 10x in the inset. A sharp, symmetric principal peak with a low related-substance burden is consistent with high chromatographic purity.

PEAK	RT (MIN)	AREA (MAU-S)	AREA %	PLATES (N)	TAILING
SLU-PP-332 (principal)	6.80	4,945,000	98.90	12,100	1.03
Related substance 1 (RRT 0.79)	5.40	25,000	0.50	8,200	1.08
Related substance 2 (RRT 1.16)	7.90	17,500	0.35	7,600	1.07
Related substance 3 (RRT 1.34)	9.10	12,500	0.25	7,100	1.10
<b>Total</b>		<b>5,000,000</b>	<b>100.00</b>		

**4 MASS CONFIRMATION**

LC-MS, ESI positive

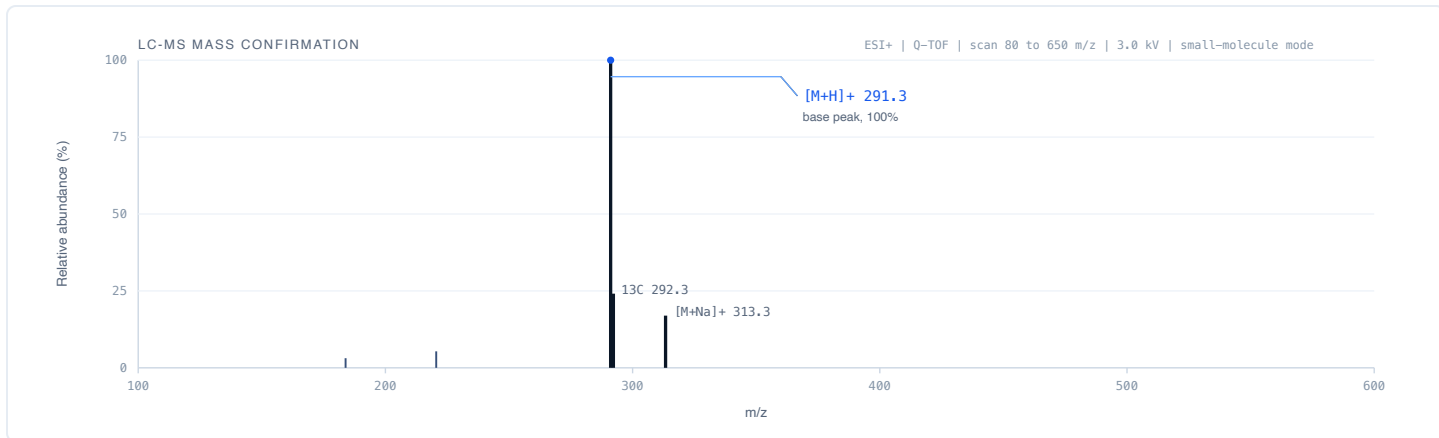

**Figure 3.** LC-MS mass confirmation (electrospray positive mode). Base peak [M+H]<sup>+</sup> at m/z 291.3 with the [M+Na]<sup>+</sup> adduct at 313.3, consistent with the 290.3 Da mass of SLU-PP-332 and confirming identity.

**5 CONFORMITY TESTING**

3 units · HPLC

SAMPLE	PURITY	NPC (MG)	IDENTITY	RESULT
V0 (dedicated)	98.96%	5.08	Confirmed	✓ PASS
V1	98.90%	5.04	Confirmed	✓ PASS
V2	98.93%	5.12	Confirmed	✓ PASS
<b>Mean</b>	<b>98.93%</b>	<b>5.08</b>	—	—
<b>Std Dev</b>	<b>0.03%</b>	<b>0.04</b>	—	—

**Interpretation.** Across three independently tested units the purity standard deviation was 0.03 percent and content standard deviation 0.04 mg, a low dispersion consistent with a homogeneous, well-controlled batch.




**Figure 4.** Purity conformity across tested units with mean and plus or minus 3 SD control band (SD 0.03%).

## 6 COMPOSITION, MOISTURE & COUNTERION

KF · IC · USP <467>

PARAMETER	METHOD	SPECIFICATION	RESULT	STATUS
Net Compound Content	HPLC assay	Report only	<b>5.08 mg</b>	REPORTED
Water (Karl Fischer)	USP <921>	NMT 8.0% w/w	<b>3.50%</b>	✓ PASS
Counterion (acetate)	Ion chromatography	Report only	<b>2.00% w/w</b>	REPORTED
Residual Solvents (TFA)	USP <467>	Not Detected	<b>Not Detected</b>	✓ PASS
Gross Fill Weight	Gravimetric	Report only	<b>5.46 mg</b>	REPORTED

**Interpretation.** Karl Fischer titration returned 3.50 percent residual water and the acetate counterion accounts for 2.00 percent by weight, both typical for a freeze-dried compound salt. The 5.46 mg gross fill reconciles compound, counterion, water, and trace related substances.

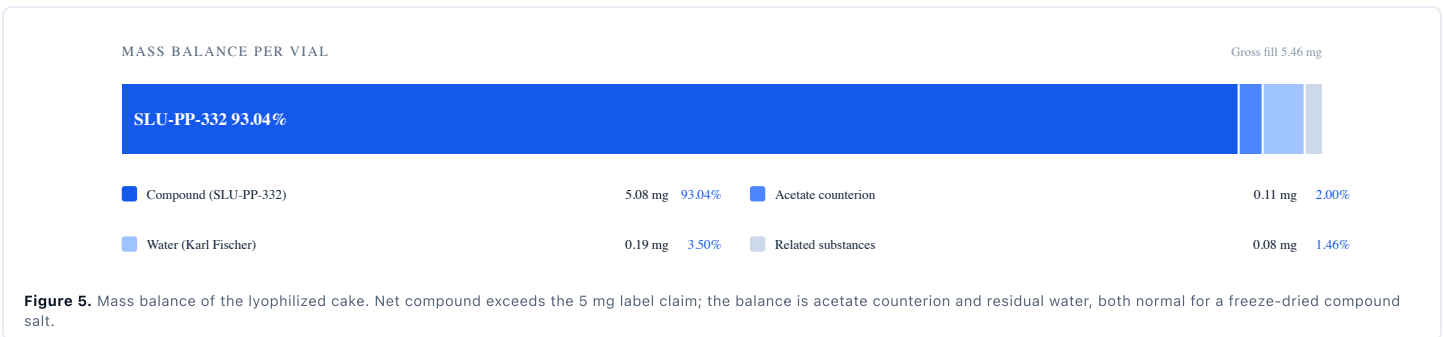

**Figure 5.** Mass balance of the lyophilized cake. Net compound exceeds the 5 mg label claim; the balance is acetate counterion and residual water, both normal for a freeze-dried compound salt.

## 7 SAFETY & CONTAMINATION CONTROLS

ICP-MS · USP <71> · <85>

TEST	METHOD	SPECIFICATION	RESULT	STATUS
Arsenic (As)	ICP-MS	NMT 1.5 ppm	<b>Not Detected</b>	✓ PASS
Cadmium (Cd)	ICP-MS	NMT 0.5 ppm	<b>Not Detected</b>	✓ PASS
Chromium (Cr)	ICP-MS	NMT 10 ppm	<b>Not Detected</b>	✓ PASS
Mercury (Hg)	ICP-MS	NMT 1.5 ppm	<b>Not Detected</b>	✓ PASS
Lead (Pb)	ICP-MS	NMT 1 ppm	<b>Not Detected</b>	✓ PASS
Sterility	USP <71>	No Growth	<b>No Growth</b>	✓ PASS
Bioburden	USP <61>	< 10 CFU/mL	<b>&lt; 1 CFU/mL</b>	✓ PASS
Bacterial Endotoxin	USP <85>	NMT 5 EU/mL	<b>NMT 0.05 EU/mL</b>	✓ PASS

**Interpretation.** By ICP-MS, arsenic, cadmium, chromium, mercury, and lead were each Not Detected below their specification thresholds. Sterility by membrane filtration returned No Growth with bioburden below the reporting limit, and bacterial endotoxin was at or below 0.05 EU/mL, approximately one percent of the 5 EU/mL limit, indicating a substantial margin of compliance.



**Figure 6.** Elemental impurity headroom by ICP-MS. All regulated elements Not Detected, well below specification.



**Figure 7.** Bacterial endotoxin safety margin (USP <85>). Result at or below 0.05 EU/mL against a 5 EU/mL limit.

**8 FOR THE RECIPIENT**

Plain-language summary

- ✓ **Purity 98.96 percent.** Almost everything in the vial is SLU-PP-332. Only 1.04 percent is trace related substances, comfortably past the 95 percent release bar.
- ✓ **You get at least the labeled amount.** Measured net compound content is 5.08 mg, at or above the 5 mg on the label, so the vial delivers a full labeled dose of active compound.
- ✓ **It is genuinely SLU-PP-332.** HPLC retention time plus an LC-MS [M+H]<sup>+</sup> ion at m/z 291.3 (neutral mass 290.3 Da) confirm the identity, so this is not a substitute or a mislabel.
- ✓ **Injectable-grade safety checks pass.** Sterility shows No Growth and bacterial endotoxin is at or below 0.05 EU/mL, roughly one percent of the limit.
- ✓ **Screened for contamination.** Arsenic, cadmium, chromium, mercury, and lead were Not Detected, and the fentanyl adulterant screen was Not Detected.
- ✓ **Water and salt are normal.** The small amounts of water (3.50 percent) and acetate (2.00 percent) are expected for a freeze-dried compound and are already accounted for in the net compound figure.

**Purity (HPLC)**

Percent of the main peptide peak relative to all detected peaks.

**Net peptide content**

Measured mass of actual peptide, separate from water and salt.

**NMT**

Not more than; an upper acceptance limit.

**Not Detected**

Below the method limit of quantitation (LOQ).

**EU/mL**

Endotoxin units per milliliter, a measure of bacterial toxin.

**RRT**

Relative retention time; an impurity position versus the main peak.

**Counterion**

The salt partner of the peptide.

**w/w**

By weight, as a percent of total mass.

**USP <71> / <85>**

Standard chapters for sterility and bacterial endotoxin.

**Karl Fischer**

Titration method for measuring residual water (USP <921>).

**Storage.** Store the sealed lyophilized vial at -20 C, protected from light. Reconstituted solution is stable at 2 to 8 C; use within 30 days. **Reconstitution.** Add bacteriostatic or sterile water down the vial wall, swirl gently, do not shake. **Handling.** Research use only; not for human or veterinary use.

**9 ANALYTICAL METHODS & NOTES**

Method principles

**HPLC Purity and Net Peptide Content**

Reversed-phase HPLC with UV detection separates the principal peptide from related substances; purity is percent main-peak area and content is quantified against a calibrated reference. Acceptance: not less than the stated release limit.

**LC-MS Mass Confirmation**

Electrospray positive-mode mass spectrometry resolves the molecular ion and isotope or charge-state signature of the analyte.

**Counterion by Ion Chromatography**

Ion chromatography determines the counterion content by weight, characterizing the peptide salt form.

**Heavy Metals by ICP-MS**

Inductively coupled plasma mass spectrometry quantifies elemental impurities against per-element limits, with results below detection reported as Not Detected.

**Bioburden by USP <61>**

Total aerobic microbial and yeast or mold counts establish microbial load prior to release.

**Identity by HPLC Retention-Time Matching**

Sample retention time is compared to a qualified reference standard under identical conditions; identity is confirmed on co-elution within the established window.

**Water Content by Karl Fischer**

Coulometric Karl Fischer titration per USP <921> quantifies residual moisture in the lyophilized cake. Acceptance: not more than 8.0 percent w/w.

**Residual Solvents**

Headspace GC per USP <467> screens process solvents; trifluoroacetic acid is assessed against a not-detected threshold.

**Sterility by USP <71>**

Membrane filtration sterility test; No Growth is reported when no microbial recovery is observed across the incubation period.

**Bacterial Endotoxin by USP <85>**

Kinetic bacterial endotoxin test; acceptance is not more than 5 EU/mL per client specification.

DocuSigned by:

11000111 10101101 01101000 01100111

DS  
FC

**Finn C.**  
Laboratory Director

Date of authorization: 06/12/2026

DocuSigned by:

00111010 00001001 11111100 01101000

DS  
BC

**Brennan C.**  
Quality Assurance

Reviewed against acceptance criteria: 06/13/2026



Authenticate this certificate

Scan the code or verify online at [titreonanalytical.com/verify](https://titreonanalytical.com/verify)

Verification ID: **TLA-2649-SLUPP-7A2F**



**Scope and disclaimer.** These results relate only to the item tested as received and do not extend to any other unit, lot, or batch; this certificate shall not be reproduced except in full without the prior written approval of the laboratory. The graphical exhibits shown, including the chromatogram, mass spectrum, composition, conformity, headroom, mass-balance, and margin panels, are rendered representations generated from the reported analytical results for illustrative clarity, with primary instrument data files retained on record. Information herein is confidential to the named client, and liability is limited to the value of the analytical service performed.